


Silver Falls School District – Silverton Middle School

Lead Testing Results Summary 11/07/2016

Prepared by Beth Myers, Lab Director

Waterlab Corp, Oregon Accredited Laboratory ORELAP 100039, EPA #0008

Page 1 of 1

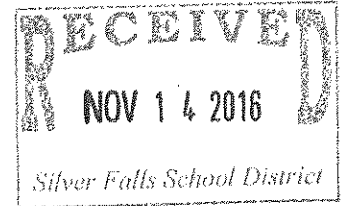

NOTE: The Lead Test Results are provided here in two (2) different units so you can choose which one you want to use on our information.

Date Collected	Lab #	Sample Site	Lead Test Results, mg/liter (or ppm) Action Level of 0.020	Lead Test Results, ppb Action Level of 20
10/20/2016	20161027-37	SMS - Conc. Stand Fountain	0.0073	7.3
10/20/2016	20161020-38	SMS Conc. Stand, inside sink	0.0051	5.1
10/20/2016	20161020-39	DO, Drinking fountain (1)	0.0017	1.7
10/20/2016	20161020-40	DO Drinking Fountain (2)	0.0013	1.3
10/20/2016	20161020-41	SMS Rm 25, Sink (1)	0.0140	14.0
10/20/2016	20161020-42	SMS Rm 25 Sink (2)	0.158	158.
10/20/2016	20161030-43	SMS Rm 25 Sink (3)	0.130	130.
10/20/2016	20161020-44	SMS Between 24-25 Sink	0.0201	20.1
10/20/2016	20161020-45	SMS Silver Wing Hall Fountain	0.0339	33.9
10/20/2016	20161020-46	SMS Rm 22 sink	0.0164	16.4
10/20/2016	20161020-47	SMS Gym Front Fountain (1)	ND @ 0.001	ND @ 1
10/20/2016	20161020-48	SMS Gym Front Fountain (2)	ND @ 0.001	ND @ 1
10/20/2016	20161020-49	SMS Gym Fountain (3)	0.0025	2.5
10/20/2016	20161020-50	SMS Girls Locker Rm Fountain	0.0076	7.6
10/20/2016	20161020-51	SMS Green Wing Hall Fountain (1)	0.0039	3.9
10/20/2016	20161020-52	SMS Detention Office sink	0.0036	3.6
10/20/2016	20161020-53	SMS Office RR sink	ND @ 0.001	ND @ 1
10/20/2016	20161020-54	SMS Green Wing Hall Fountain (2)	0.0014	1.4
10/20/2016	20161020-55	SMS Staff Lounge Sink	0.0044	4.4
10/20/2016	20161020-56	SMS Kitchen (1)	ND @ 0.001	ND @ 1
10/20/2016	20161020-57	SMS Kitchen (2)	ND @ 0.001	ND @ 1
10/20/2016	20161020-58	SMS Kitchen (3)	0.0132	13.2
10/20/2016	20161020-59	SMS Black Wing Rm 21 Sink (1)	0.0109	10.9
10/20/2016	20161020-60	SMS black Wing Rm 21 Sink (2)	0.0015	1.5

ND means No Detection at stated value.

*** Sample Size 250 mL Containers